


LOCUS MAP

NOT TO SCALE

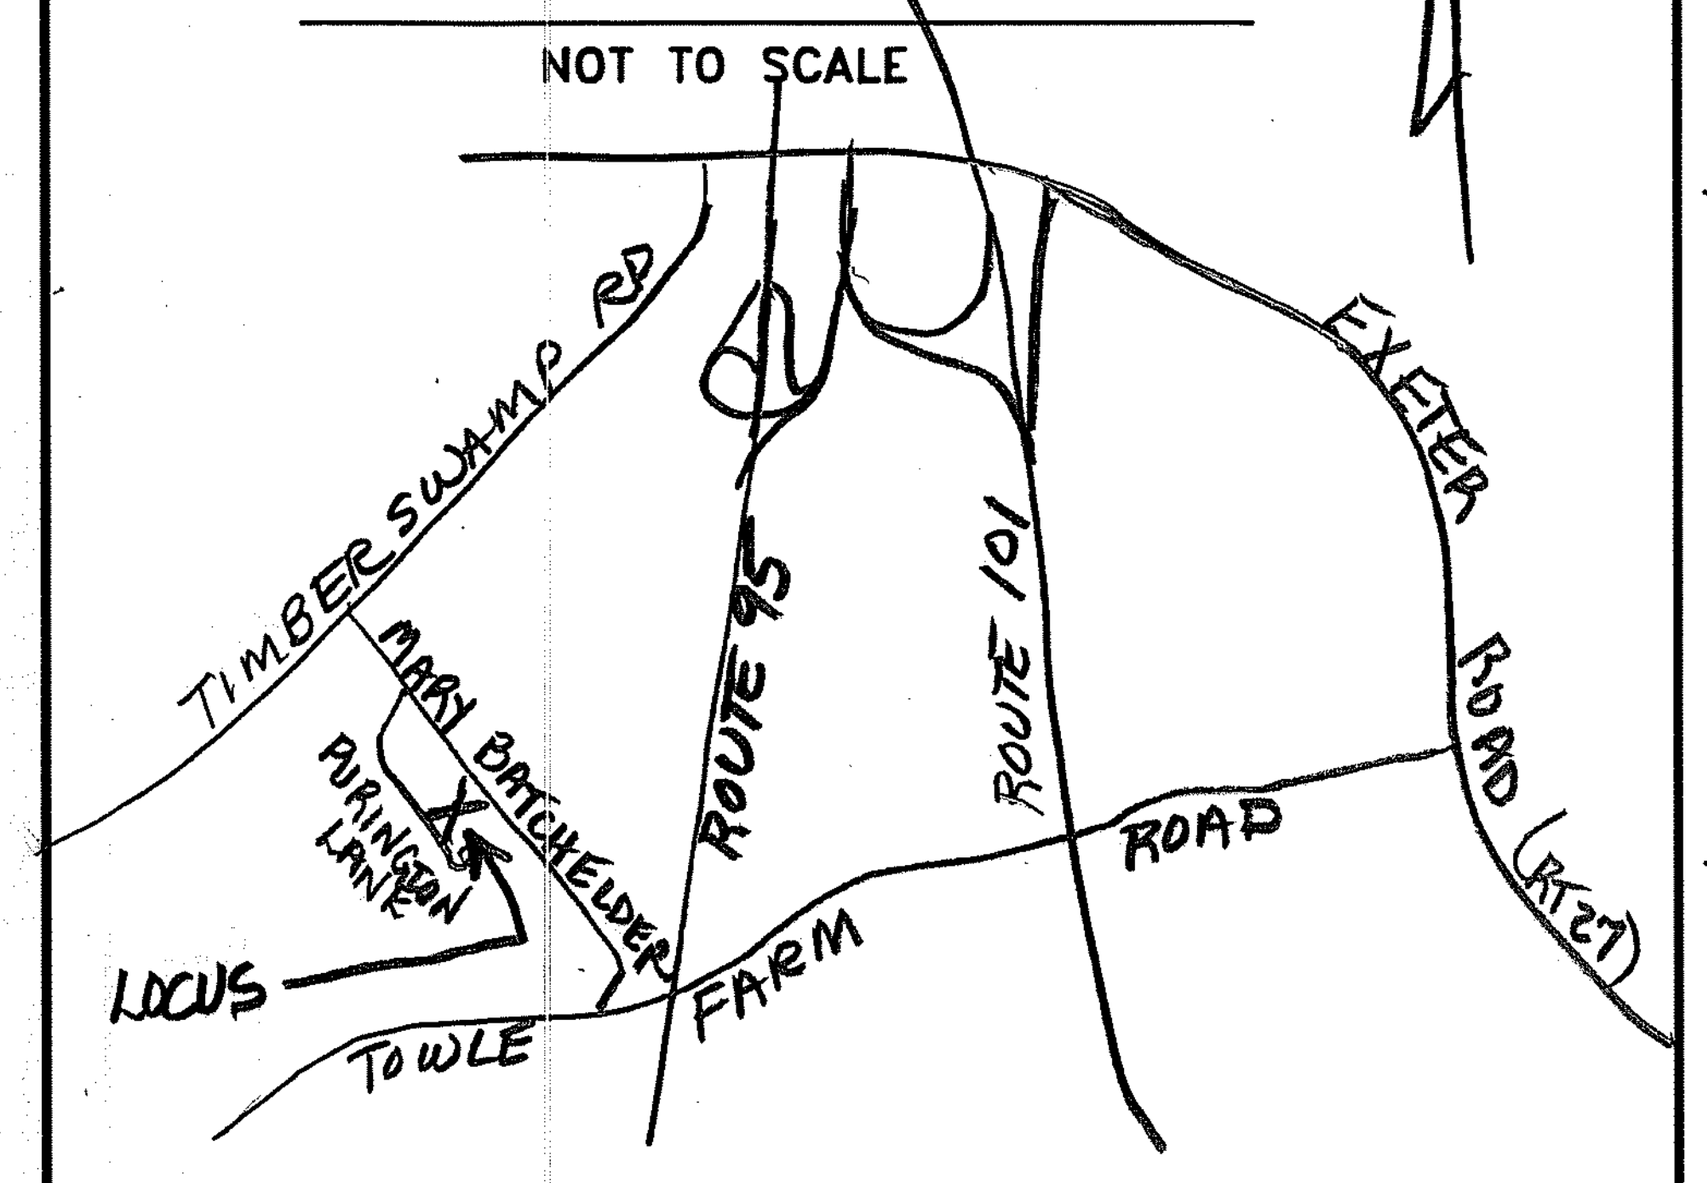

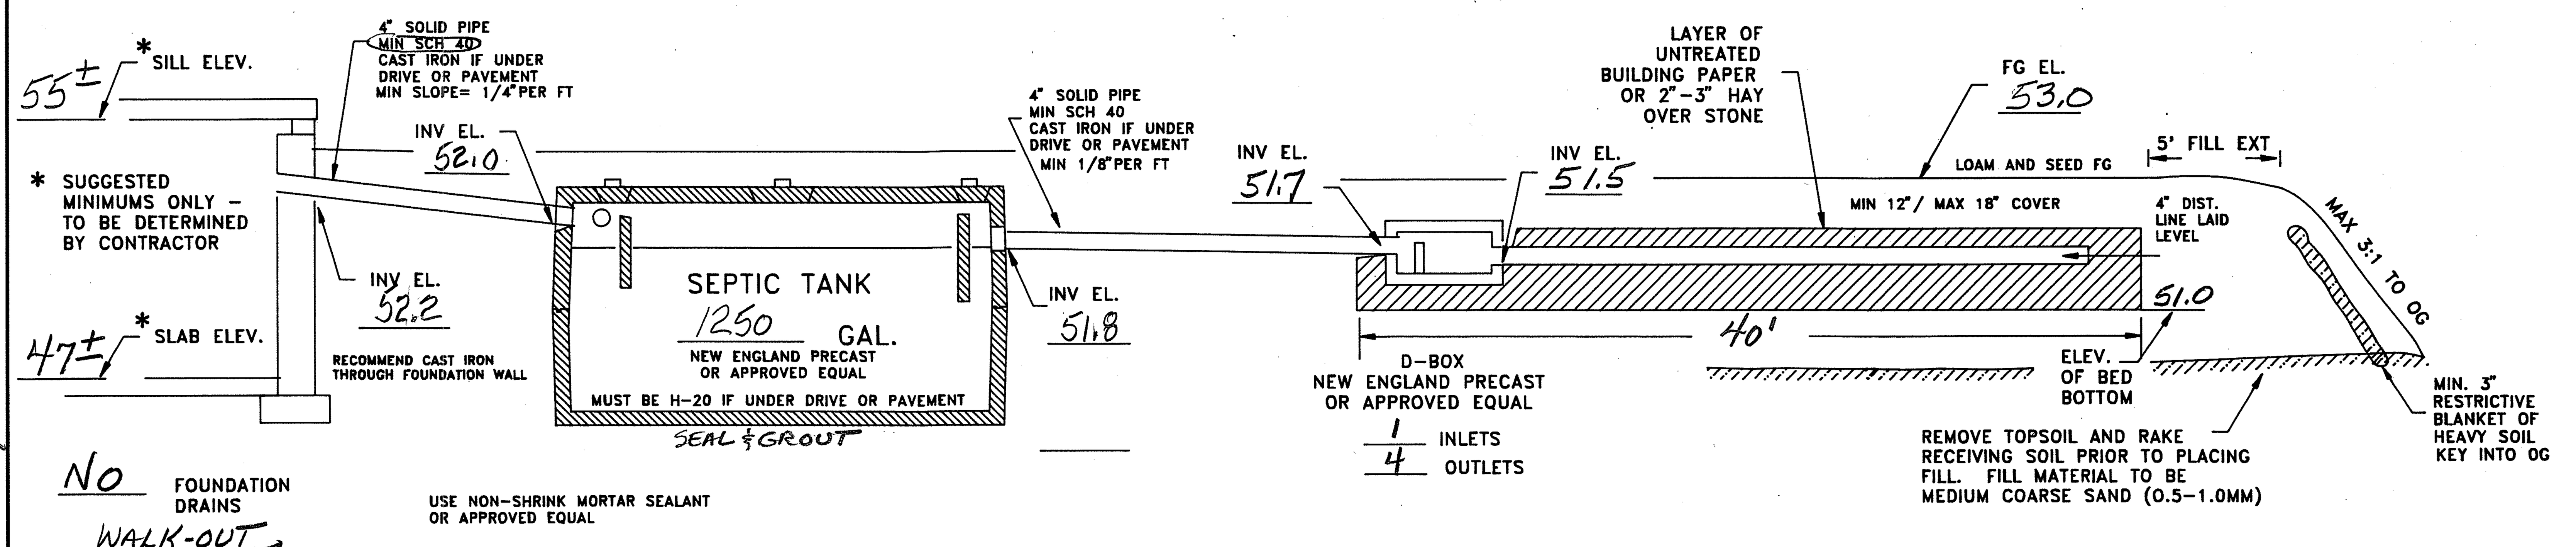

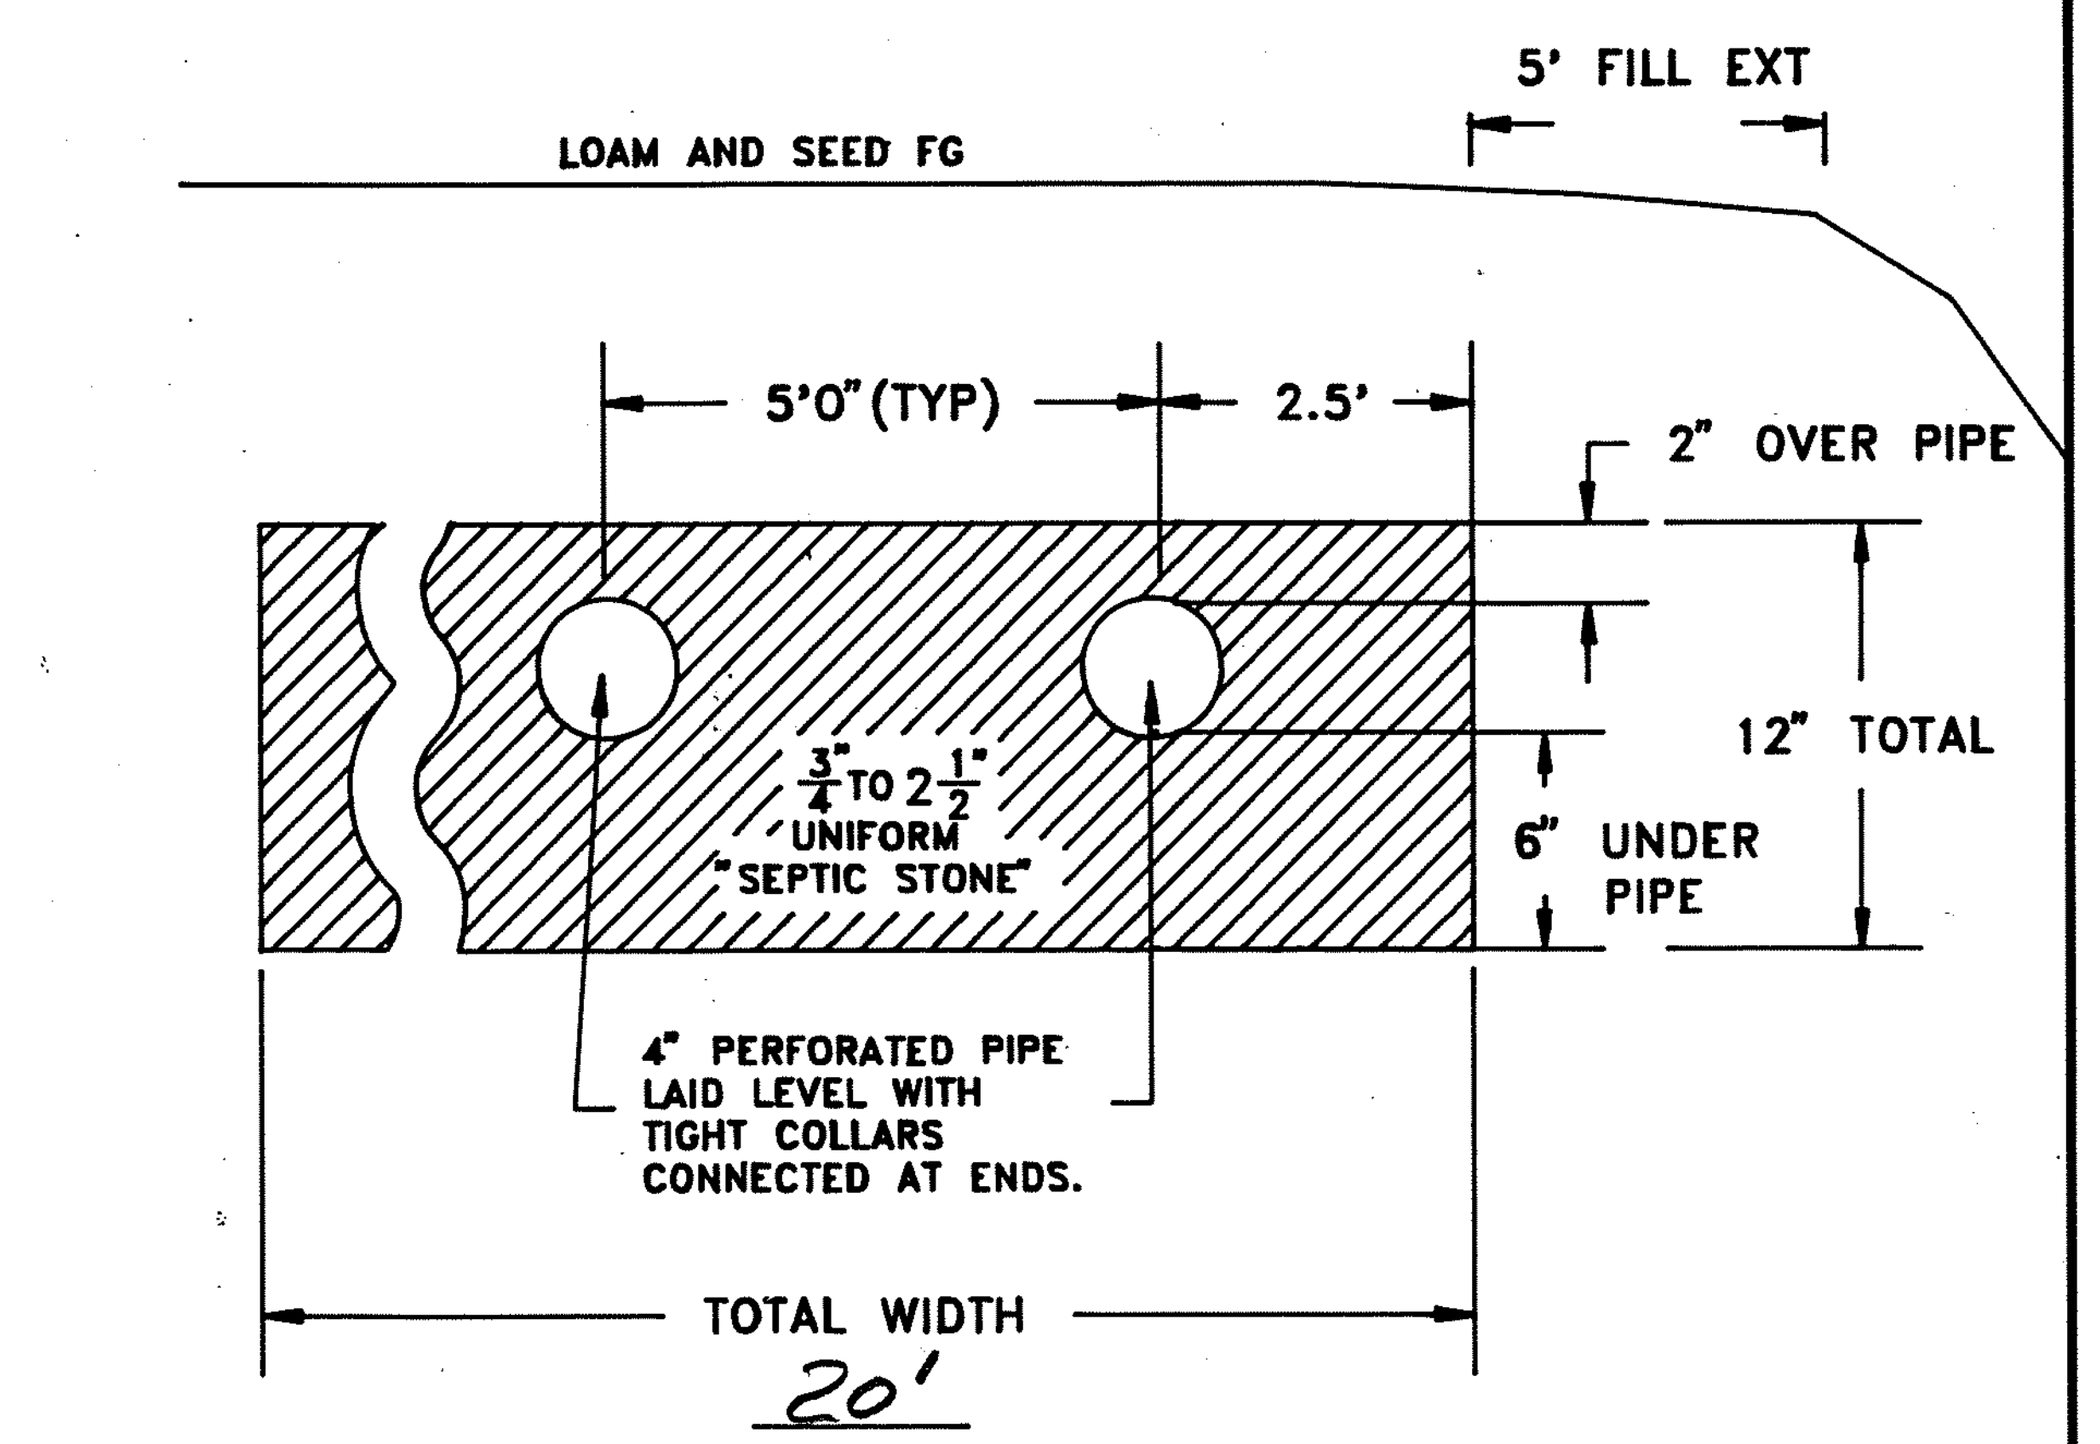

CROSS SECTION DISPOSAL SYSTEM – NOT TO SCALE

SOIL CLASS: 40B CHATFIELD-HOLLIS-CANTON

(SOURCE: USDA-SCS SOIL SURVEY)

BENCH MARKS: DATUM = ASSUMED

#1 TOP IRON PIN EL 52.02

#2 SET NAIL 10" HICK. EL 50.58

#3 SET NAIL 24" OAK EL 49.35

#4 SET NAIL 30" OAK EL 46.92

DESIGN INTENT: BED BOTTOM TO BE PLACED NO LOWER THAN 6" ABOVE EXISTING GRADE, UPSLOPE SIDE (EXIS GRADE = EL 50.5). EQUALS 14" ABOVE GRADE AT EL 49.8 50%± OF BED AREA DOWNSLOPE

SUITABLE REPLACEMENT AREA:

SYSTEM MUST BE REBUILT IN PLACE OR REDESIGNED.


LEGEND:

Symbol	Meaning
50	EXISTING CONTOUR
(50)	PROPOSED CONTOUR
50.0	EXISTING SPOT ELEVATION
(50.0)	PROPOSED SPOT ELEVATION

NOTES:

1. THIS PLAN IS NOT TO BE CONSTRUED AS A BOUNDARY SURVEY. PROPERTY LINES SHOWN ARE APPROXIMATED BASED ON INFORMATION FROM THE FOLLOWING SOURCE: RCRP PLAN # D16264
2. NHDES-WS&PCD SUBDIVISION APPROVAL NUMBER: # 23192
3. THIS SYSTEM IS NOT DESIGNED TO HANDLE GARBAGE DISPOSAL WASTE.
4. NO SURFACE WATER OR WELL WITHIN 75' OF PROPOSED SYSTEM.

PLAN : 1"=20'

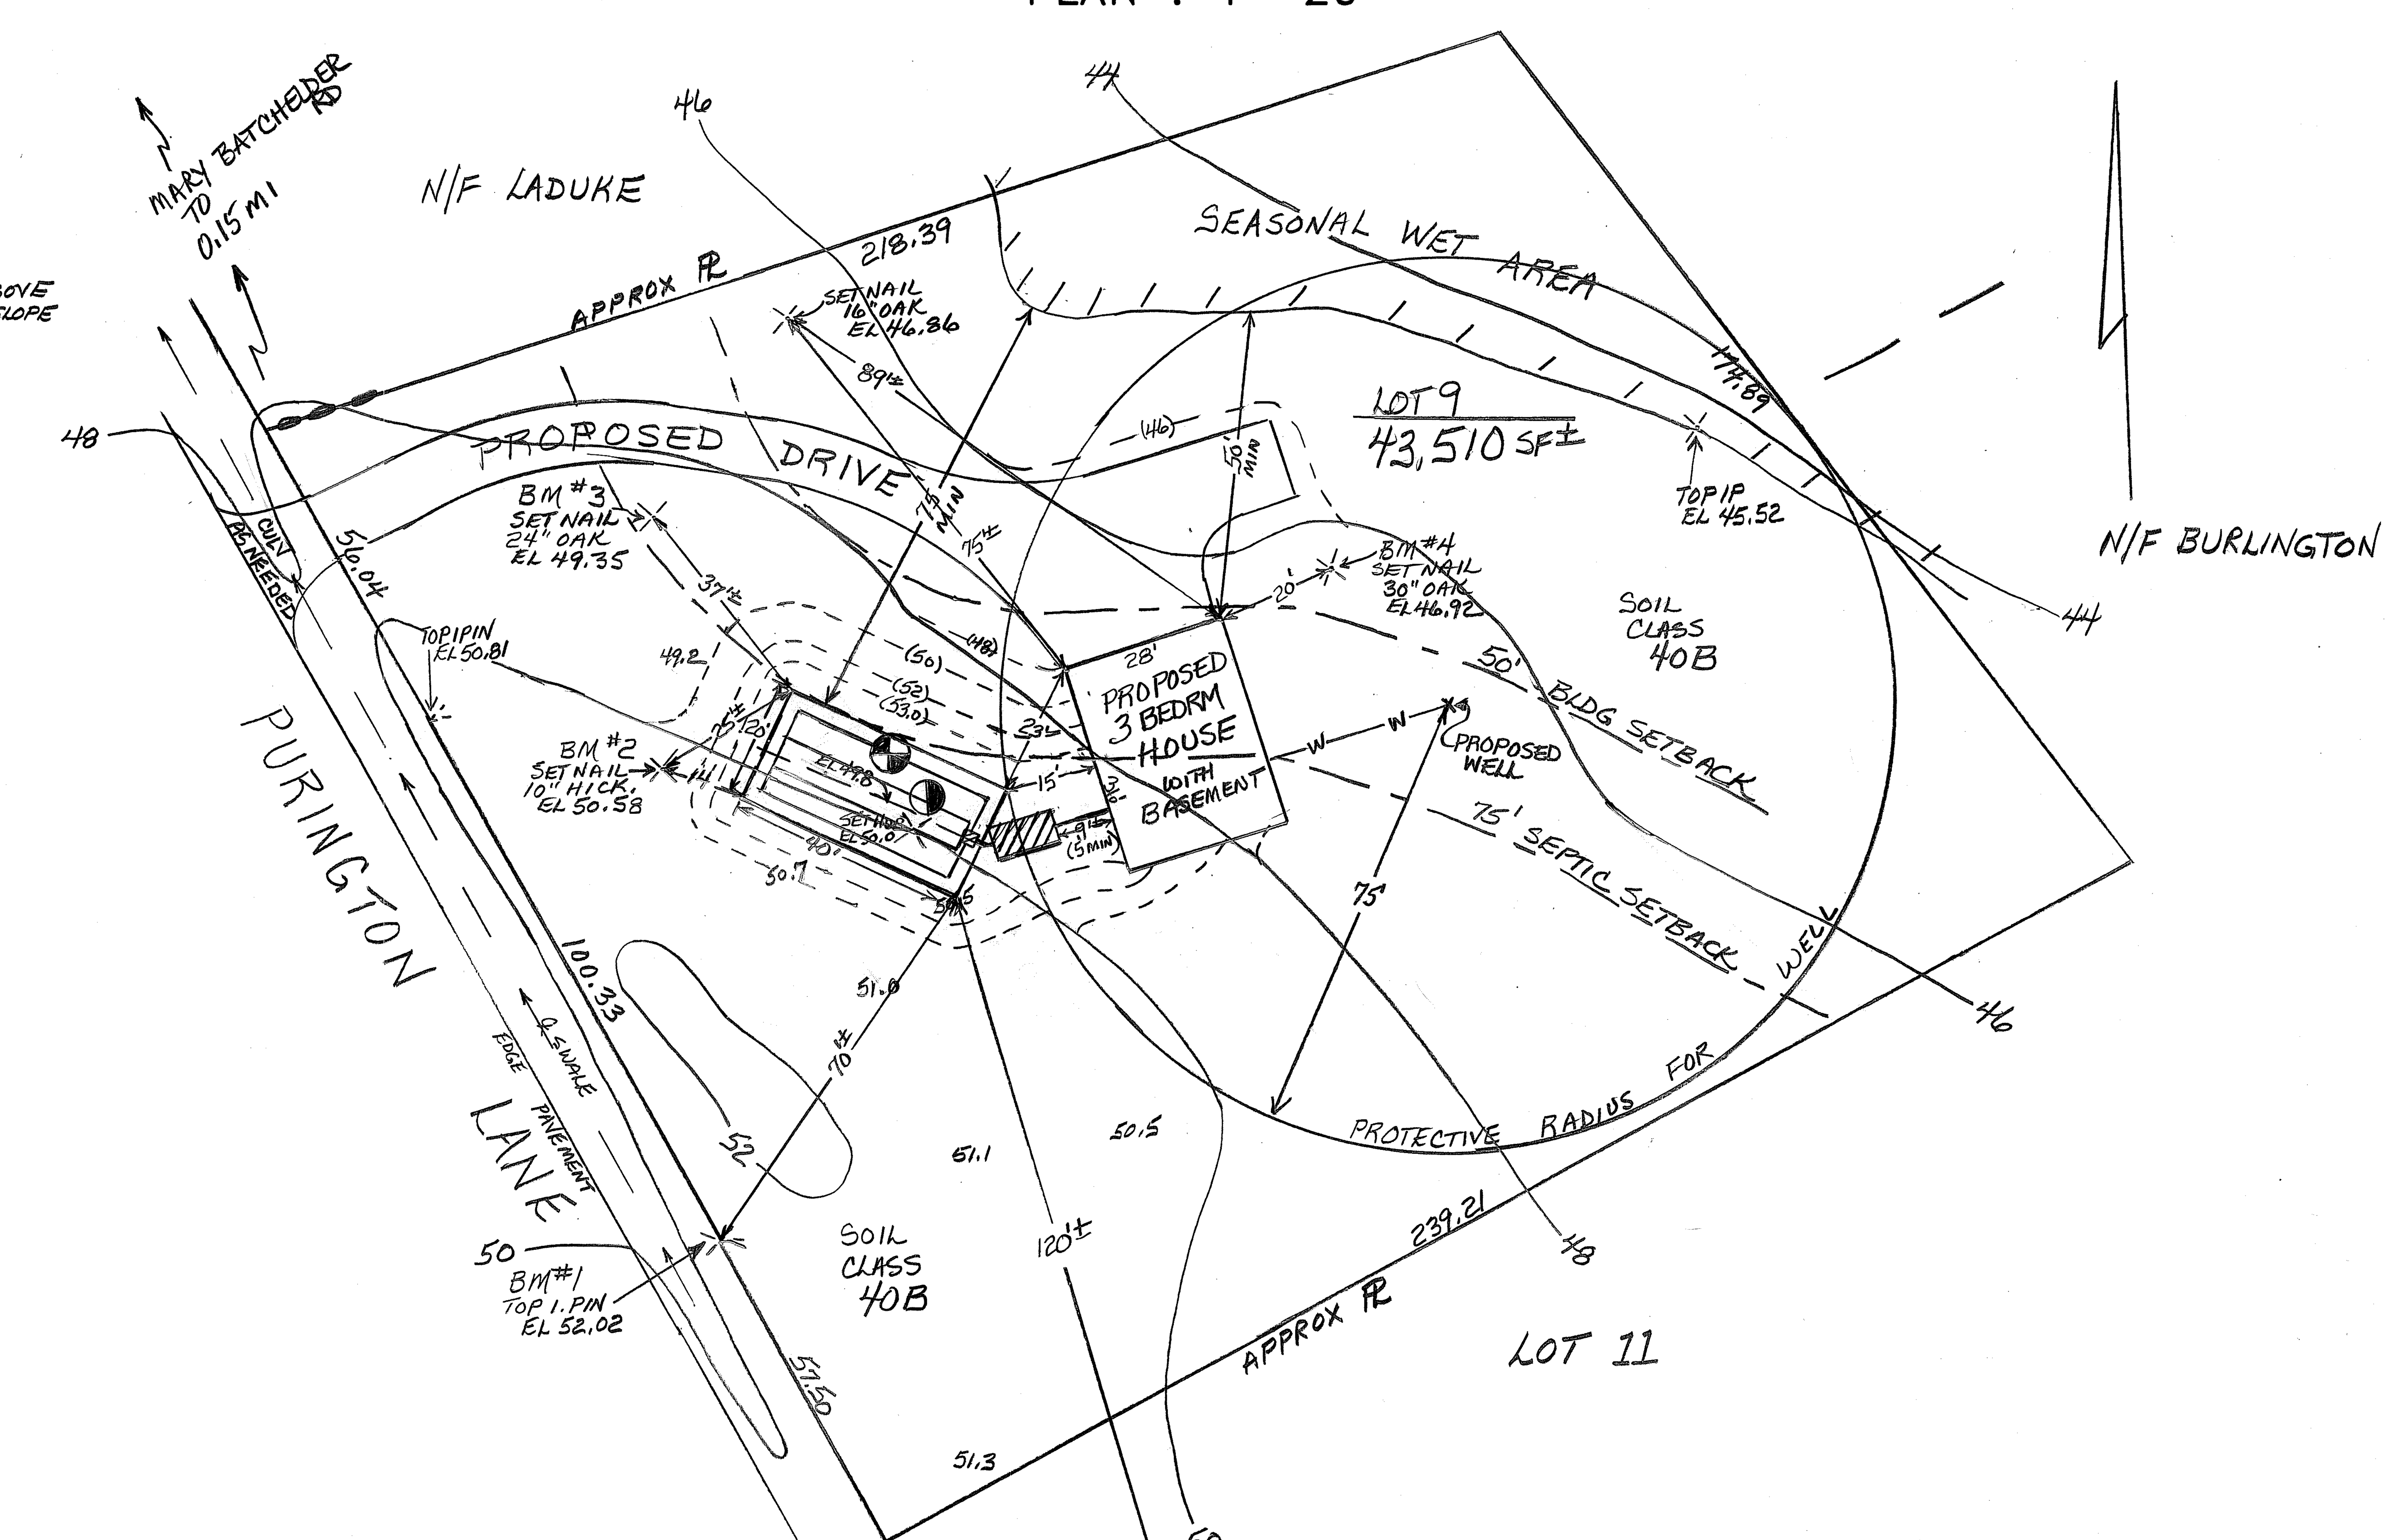

SYSTEM OWNER IS RESPONSIBLE FOR THE FOLLOWING OPERATING REQUIREMENTS

ENV–WS 1023.01 (a) SEPTIC TANKS SHALL BE INSPECTED FOR ACCUMULATION OF SLUDGE AND SURFACE SCUM AT LEAST ONCE EVERY YEAR.
(b) WHEN THE COMBINED THICKNESS OF SLUDGE AND SURFACE SCUM EQUAL 1/3 OR MORE OF THE TANK DEPTH, THE TANK SHALL BE PUMPED BY A LICENSED SEPTIC TANK PUMPER.

ENV–WS 1023.02 TO PREVENT OBSTRUCTION OF THE DISTRIBUTION LINES AND LEACH FIELD, GREASE AND BULKY WASTE SHALL NOT BE FLUSHED OR OTHERWISE INTRODUCED INTO THE SEPTIC SYSTEM.

ENV–WS 1023.03 TOXIC AND HAZARDOUS MATERIALS SHALL NOT BE FLUSHED OR OTHERWISE INTRODUCED INTO THE SEPTIC SYSTEM.

ENV–WS 1023.04 TO PREVENT DAMAGE TO THE DISTRIBUTION LINES AND LEACH FIELD, VEHICLES, LIVESTOCK, AND OTHER HEAVY OBJECTS SHALL NOT BE ALLOWED ON THE LEACH FIELD.

ENV–WS 1023.05 IF WET AREAS APPEAR ON THE GROUND SURFACE ABOVE THE DISTRIBUTION LINES OR LEACH FIELD OR IF DISAGREEABLE ODORS OCCUR, THE SYSTEM SHALL BE INSPECTED FOR THE SOURCE OF THESE PROBLEMS, AND CORRECTIVE ACTION SHALL BE TAKEN.

PLOT PLAN

1"=APPROX ________

TP TEST PIT DATA

DATE: 4/19/95

TOWN INSPECTOR: N/A

TEST PIT EL 49.3

0-4" LOAM & ROOT MAT

4"-34" 10 YR 4/6 (DARK YELLOWISH BROWN) GRAVELLY FINE SANDY LOAM GRANULAR FRIABLE (SOME STONES)

34"-68" 2.5 Y 5/4 (LIGHT OLIVE BROWN) GRAVELLY FINE SANDY LOAM, MOTTLED MASSIVE FRIABLE (SOME STONES)

ESHWT @ 34", ROOTS TO 4'±, NO OBS H_2O

NO REFUSAL

PT PERC TEST DATA

DATE 4/19/95

PERC RATE: 8 MIN/IN DEPTH: 26"

DESIGN LOADING: 3 BEDROOMS

AREA REQUIRED: 750 SF

AREA PROPOSED: 20 × 40 = 800 SF

PROPOSED

SEPTIC SYSTEM PLAN

LOCUS: LOT 9 PURINGTON LANE
HAMPTON, NH

OWNER: PAUL LEPERE
C/O ERA THE HAMPTONS
ROUTE 1
HAMPTON FALLS, NH 03844

NEW HAMPSHIRE Designer of Subsurface Disposal Systems
Ann W. Bialobrzeski No. 348
Water Supply & Pollution Control

APPLICANT:
STOCKTON SERVICES
PO BOX 1306
HAMPTON, NH 03842

DATE: 5/1/94

APPROVAL: CA1995001934